

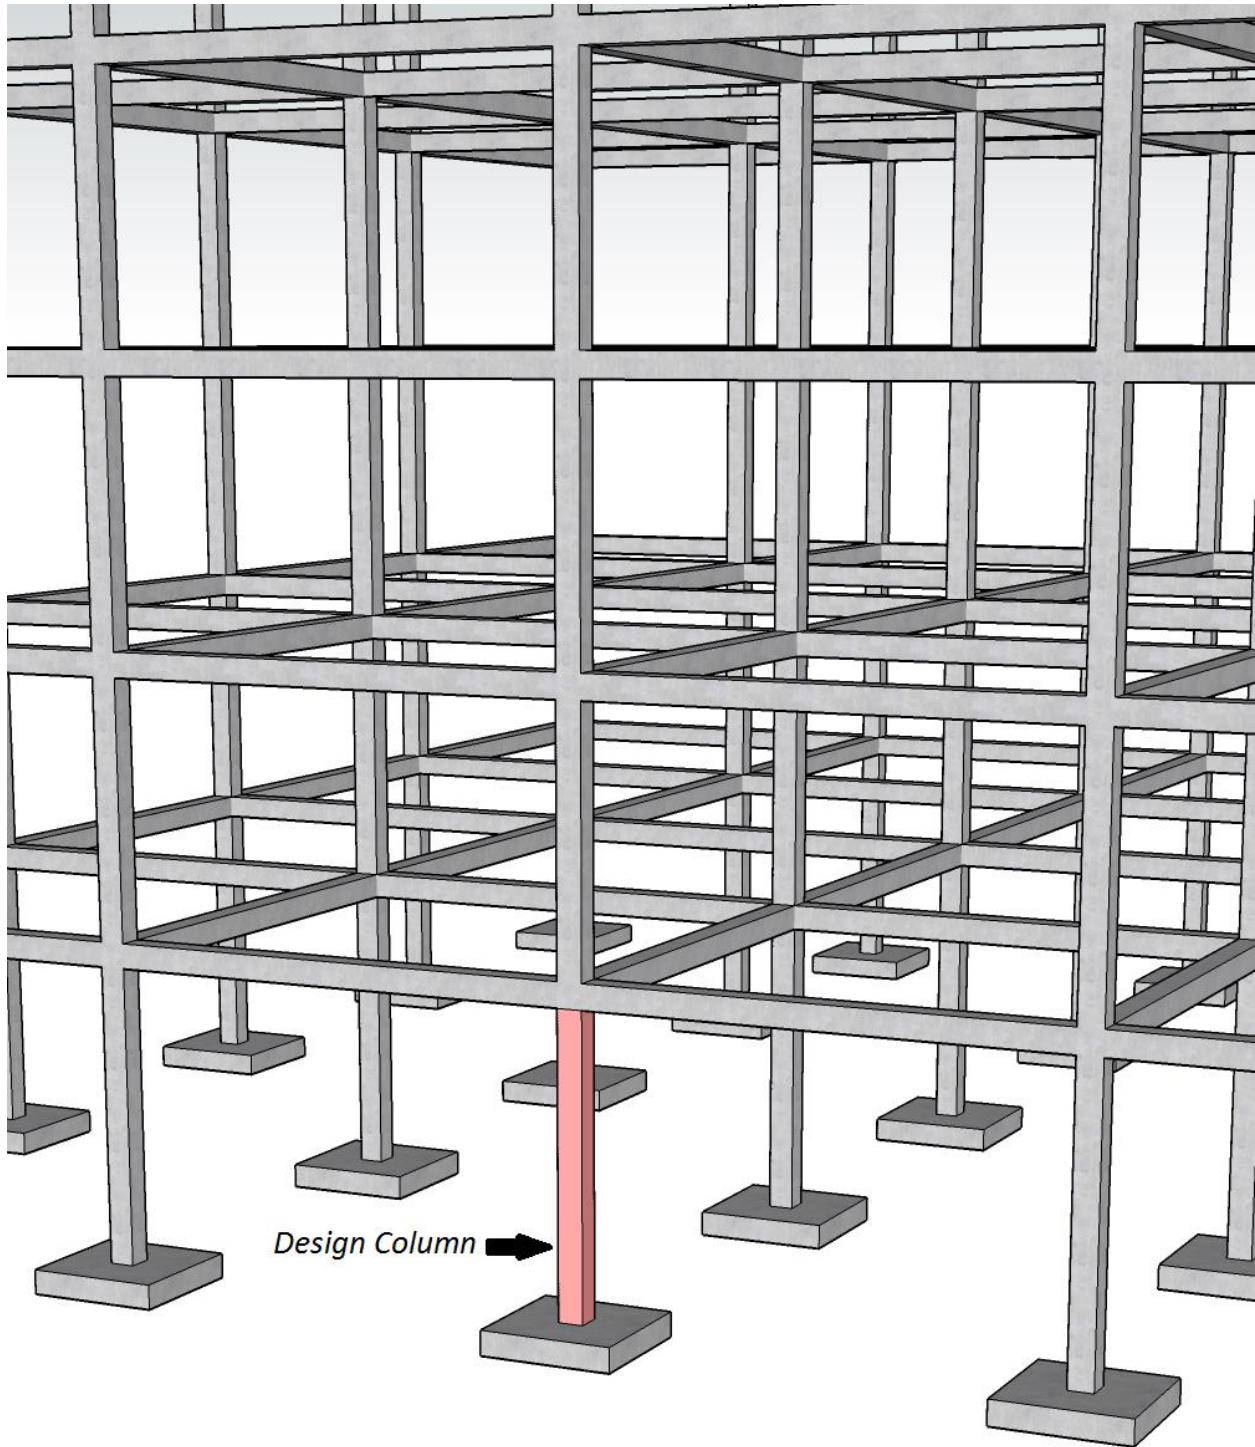
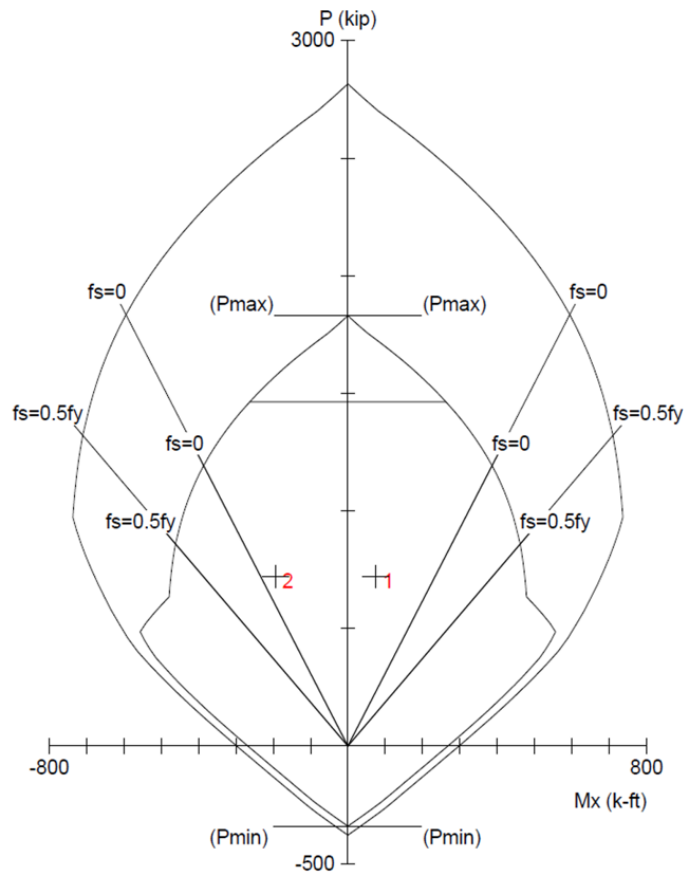


Slenderness Effects for Concrete Columns in Sway Frame - Moment Magnification Method

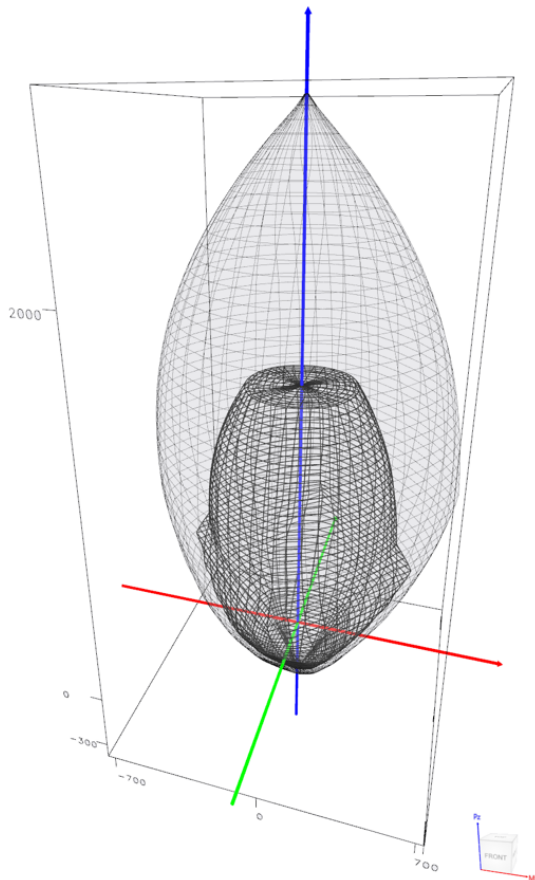

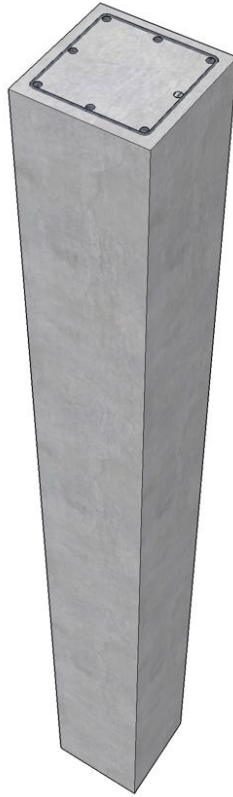

Slender Concrete Column Design in Sway Frame Buildings

Evaluate slenderness effect for columns in a sway frame multistory reinforced concrete building by designing the first story exterior column. The clear height of the first story is 13 ft-4 in., and is 10 ft-4in. for all of the other stories. Lateral load effects on the building are governed by wind forces. Compare the calculated results with the values presented in the Reference and with exact values from [spColumn](#) engineering software program from [StructurePoint](#).

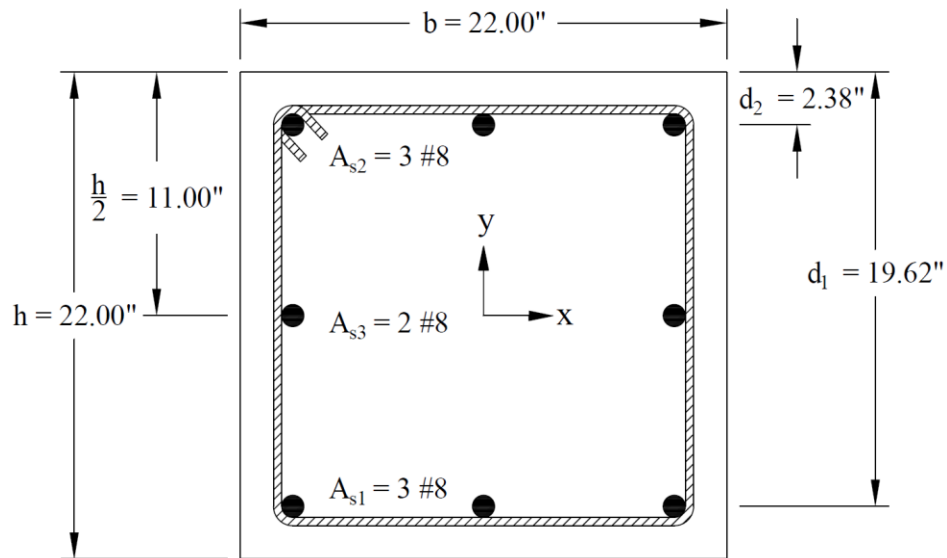


Figure 1 – Reinforced Concrete Column Cross-Section

Contents

1. Factored Axial Loads and Bending Moments	2
1.1. Service loads	2
1.2. Load Combinations – Factored Loads	2
2. Slenderness Effects and Sway or Nonsway Frame Designation	3
3. Determine Slenderness Effects.....	4
4. Moment Magnification at Ends of Compression Member	5
5. Moment Magnification along Length of Compression Member	11
6. Column Design.....	16
6.1. c , a , and strains in the reinforcement	16
6.2. Forces in the concrete and steel.....	17
6.3. ϕP_n and ϕM_n	17
7. Column Interaction Diagram - spColumn Software	19
8. Summary and Comparison of Design Results.....	28
9. Conclusions & Observations	30

Code

Building Code Requirements for Structural Concrete (ACI 318-14) and Commentary (ACI 318R-14)

Reference

Notes on ACI 318-11 Building Code Requirements for Structural Concrete, Twelfth Edition, 2013 Portland Cement Association, Example 11-2

Design Data

$f_c' = 6,000$ psi for columns in the bottom two stories

= 4,000 psi elsewhere

$f_y = 60,000$ psi

Slab thickness = 7 in.

Exterior Columns = 22 in. x 22 in.

Interior Columns = 24 in. x 24 in.

Beams = 24 in. x 20 in. x 24 ft

Superimposed dead load = 30 psf

Roof live load = 30 psf

Floor live load = 50 psf

Wind loads computed according to ASCE 7-10

Total building loads in the first story from structural analysis:

D = 17,895 kip

L = 1,991 kip

$L_r = 270$ kip

W = 0 kip, wind loads in the story cause compression in some columns and tension in others and thus would cancel out.

1. Factored Axial Loads and Bending Moments

1.1. Service loads

Load Case	Axial Load, kip	Bending Moment, ft-kip	
		Top	Bottom
Dead, D	622.4	34.8	17.6
Live, L	73.9	15.4	7.7
Roof Live, L_r	8.6	0.0	0.0
Wind, W (N-S)	-48.3	17.1	138.0
Wind, W (S-N)	48.3	-17.1	-138.0

1.2. Load Combinations – Factored Loads

ASCE 7-10 (2.3.2)

ASCE 7-10 Reference	No.	Load Combination	Axial Load, kip	Bending Moment, ft-kip		$M_{Top,ns}$ ft-kip	$M_{Bottom,ns}$ ft-kip	$M_{Top,s}$ ft-kip	$M_{Bottom,s}$ ft-kip
				Top	Bottom				
2.3.2-1	1	1.4D	871.4	48.7	24.6	48.7	24.6	---	---
2.3.2-2	2	1.2D + 1.6L + 0.5 L_r	869.4	66.4	33.4	66.4	33.4	---	---
2.3.2-3	3	1.2D + 0.5L + 1.6 L_r	797.6	49.5	25.0	49.5	25.0	---	---
	4	1.2D + 1.6 L_r + 0.8W	722.0	55.4	131.5	41.8	21.1	13.7	110.4
	5	1.2D + 1.6 L_r - 0.8W	799.3	28.1	-89.3	41.8	21.1	-13.7	-110.4
2.3.2-4	6	1.2D + 0.5L + 0.5 L_r + 1.6W	710.9	76.8	245.8	49.5	25.0	27.4	220.8
	7	1.2D + 0.5L + 0.5 L_r - 1.6W	865.4	22.1	-195.8	49.5	25.0	-27.4	-220.8
2.3.2-6	8	0.9D + 1.6W	482.9	58.7	236.6	31.3	15.8	27.4	220.8
	9	0.9D - 1.6W	637.4	4.0	-205.0	31.3	15.8	-27.4	-220.8

2. Slenderness Effects and Sway or Nonsway Frame Designation

Columns and stories in structures are considered as non-sway frames if the increase in column end moments due to second-order effects does not exceed 5% of the first-order end moments, or the stability index for the story (Q) does not exceed 0.05. ACI 318-14 (6.6.4.3)

$\sum P_u$ is the total vertical load in the first story corresponding to the lateral loading case for which $\sum P_u$ is greatest (without the wind loads, which would cause compression in some columns and tension in others and thus would cancel out). ACI 318-14 (6.6.4.4.1 and R6.6.4.3)

V_{us} is the factored horizontal story shear in the first story corresponding to the wind loads, and Δ_o is the first-order relative deflection between the top and bottom of the first story due to V_u . ACI 318-14 (6.6.4.4.1 and R6.6.4.3)

From Table 2, load combinations (2.3.2-4 No. 5 and 6) provide the greatest value of $\sum P_u$.

$$\sum P_u = 1.2 \times D + 0.5 \times L + 0.5 \times L_r = 1.2 \times 17,895 + 0.5 \times 1,991 + 0.5 \times 270 = 22,605 \text{ kip} \quad \text{ASCE 7-10 (2.3.2-4)}$$

$$V_{us} = 1.6 \times V_s = 1.6 \times 302.6 = 484.2 \text{ kip} \quad \text{ASCE 7-10 (2.3.2-6)}$$

$$\Delta_o = 1.6 \times \Delta = 1.6 \times (0.28 - 0) = 0.45 \text{ in.}$$

$$Q = \frac{\sum P_u \times \Delta_o}{V_{us} \times l_c} = \frac{22,605 \times 0.45}{484.2 \times (15 \times 12 - 20 / 2)} = 0.12 > 0.05 \quad \text{ACI 318-14 (Eq. 6.6.4.4.1)}$$

Thus, the frame at the first story level is considered sway.

3. Determine Slenderness Effects

$$I_{column} = 0.7 \times \frac{c^4}{12} = 0.7 \times \frac{22^4}{12} = 13,665 \text{ in.}^4$$

ACI 318-14 (Table 6.6.3.1.1(a))

$$E_c = 57,000 \times \sqrt{f'_c} = 57,000 \times \sqrt{6000} = 4,415 \text{ ksi}$$

ACI 318-14 (19.2.2.1.b)

For the column below level 2:

$$\frac{E_c \times I_{column}}{l_c} = \frac{4,415 \times 13,665}{15 \times 12 - 20/2} = 355 \times 10^3 \text{ in.kip}$$

For the column above level 2:

$$\frac{E_c \times I_{column}}{l_c} = \frac{4,415 \times 13,665}{12 \times 12} = 419 \times 10^3 \text{ in.kip}$$

For beams framing into the columns:

$$\frac{E_b \times I_{beam}}{l_b} = \frac{3,605 \times 5,600}{24 \times 12} = 70 \times 10^3 \text{ in.kip}$$

Where:

$$E_b = 57,000 \times \sqrt{f'_c} = 57,000 \times \sqrt{4000} = 3,605 \text{ ksi}$$

ACI 318-14 (19.2.2.1.b)

$$I_{beam} = 0.35 \times \frac{b \times h^3}{12} = 0.35 \times \frac{24 \times 20^3}{12} = 5,600 \text{ in.}^4$$

ACI 318-14 (Table 6.6.3.1.1(a))

$$\Psi_A = \frac{\left(\sum \frac{EI}{l_c} \right)_{columns}}{\left(\sum \frac{EI}{l} \right)_{beams}} = \frac{355 + 419}{70} = 11$$

ACI 318-14 (Figure R6.2.5)

$$\Psi_B = 1.0 \text{ (Column essentially fixed at base)}$$

ACI 318-14 (Figure R6.2.5)

Using Figure R6.2.5 from ACI 318-14 $\rightarrow k = 1.9$ as shown in the figure below for the exterior columns with one beam framing into them in the directions of analysis.

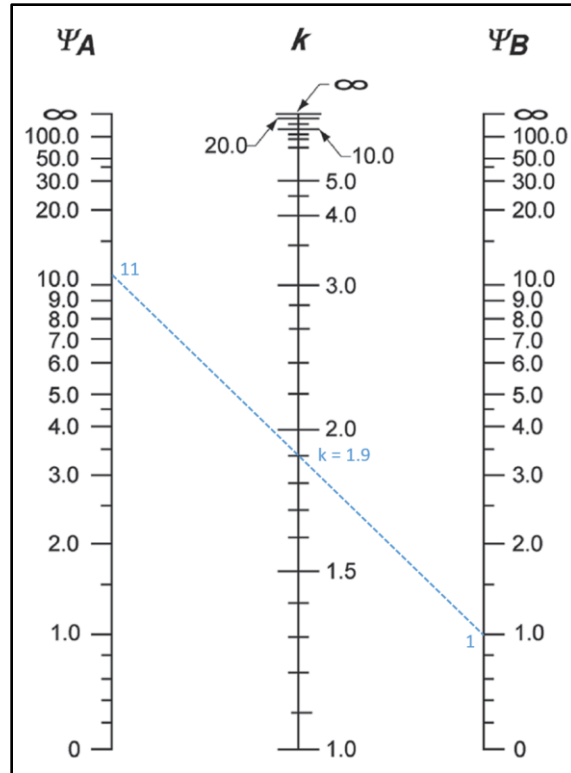


Figure 2 – Effective Length Factor (k) Calculations for Exterior Columns with One Beam Framing into them in the Direction of Analysis (Sway Frame)

$$\frac{k \times l_u}{r} = \frac{1.9 \times 13.333}{6.6} = 47.87 > 22 \rightarrow \text{Consider Slenderness}$$

ACI 318-14 (6.2.5a)

Where:

$$r = \text{radius of gyration} = (a) \sqrt{\frac{I_g}{A_g}} \quad \text{or} \quad (b) 0.3 \times c_1$$

ACI 318-14 (6.2.5.1)

$$r = \sqrt{\frac{I_g}{A_g}} = \sqrt{\frac{c_1^2}{12}} = \sqrt{\frac{22^2}{12}} = 6.35 \text{ in.}$$

4. Moment Magnification at Ends of Compression Member

A detailed calculation for load combination 4 (gravity plus wind) is shown below to illustrate the procedure. Table 3 summarizes the magnified moment computations for the exterior columns.

$$M_2 = M_{2ns} + \delta_s M_{2s}$$

ACI 318-14 (6.6.4.6.1b)

Where:

$$\delta_s = \text{moment magnifier} = \left\{ \begin{array}{l} \text{(a)} \quad \frac{1}{1-Q} \\ \text{(b)} \quad \frac{1}{1 - \frac{\sum P_u}{0.75 \sum P_c}} \\ \text{(c)} \quad \text{Second-order elastic analysis} \end{array} \right\} \quad \underline{\underline{ACI 318-14 (6.6.4.6.2)}}$$

ACI 318-14 (6.6.4.6.2(b)) will be used for comparison purposes with results obtained from [spColumn](#) model. However, (a) and (c) can also be used to calculate the moment magnifier.

$\sum P_u$ is the summation of all the factored vertical loads in the first story, and $\sum P_c$ is the summation of the critical buckling load for all sway-resisting columns in the first story.

$$P_c = \frac{\pi^2 (EI)_{eff}}{(kl_u)^2} \quad \underline{\underline{ACI 318-14 (6.6.4.4.2)}}$$

Where:

$$(EI)_{eff} = \left\{ \begin{array}{l} \text{(a)} \quad \frac{0.4E_c I_g}{1 + \beta_{ds}} \\ \text{(b)} \quad \frac{0.2E_c I_g + E_s I_{se}}{1 + \beta_{ds}} \\ \text{(c)} \quad \frac{E_c I}{1 + \beta_{ds}} \end{array} \right\} \quad \underline{\underline{ACI 318-14 (6.6.4.4.4)}}$$

There are three options for calculating the effective flexural stiffness of slender concrete columns $(EI)_{eff}$. The second equation provides accurate representation of the reinforcement in the section and will be used in this example and is also used by the solver in [spColumn](#). Further comparison of the available options is provided in “[Effective Flexural Stiffness for Critical Buckling Load of Concrete Columns](#)” technical note.

$$I_{column} = \frac{c^4}{12} = \frac{22^4}{12} = 19,521 \text{ in.}^4 \quad \underline{\underline{ACI 318-14 (Table 6.6.3.1.1(a))}}$$

$$E_c = 57,000 \times \sqrt{f'_c} = 57,000 \times \sqrt{6000} = 4,415 \text{ ksi} \quad \underline{\underline{ACI 318-14 (19.2.2.1.a)}}$$

β_{ds} is the ratio of maximum factored sustained shear within a story to the maximum factored shear in that story associated with the same load combination. The maximum factored sustained shear in this example is equal to zero leading to $\beta_{ds} = 0$. ACI 318-14 (6.6.3.1.1)

For exterior columns with one beam framing into them in the direction of analysis (12 columns):

With 8-#8 reinforcement equally distributed on all sides and 22 in. x 22 in. column section $\rightarrow I_{se} = 352.6 \text{ in.}^4$.

$$(EI)_{eff} = \frac{0.2E_c I_g + E_s I_{se}}{1 + \beta_{ds}} \quad \underline{\underline{ACI 318-14 (6.6.4.4.4(b))}}$$

$$(EI)_{eff} = \frac{0.2 \times 4,415 \times 19,521 + 29,000 \times 352.6}{1+0} = 27.5 \times 10^6 \text{ kip-in.}^2$$

$k = 1.9$ (calculated previously).

$$P_{c1} = \frac{\pi^2 \times 27.5 \times 10^6}{(1.9 \times 13.333)^2} = 2,933 \text{ kip}$$

For exterior columns with two beams framing into them in the direction of analysis (4 columns):

$$\Psi_A = \frac{\left(\sum \frac{EI}{l_c} \right)_{columns}}{\left(\sum \frac{EI}{l} \right)_{beams}} = \frac{355 + 419}{70 + 70} = 5.5$$

ACI 318-14 (Figure R6.2.5)

$\Psi_B = 1.0$ (Column essentially fixed at base)

ACI 318-14 (Figure R6.2.5)

Using Figure R6.2.5 from ACI 318-14 $\rightarrow k = 1.71$ as shown in the figure below for the exterior columns with two beams framing into them in the directions of analysis.

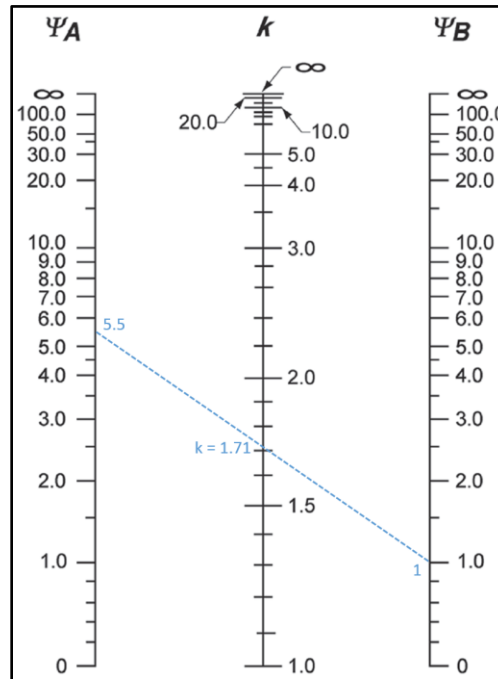


Figure 3 – Effective Length Factor (k) Calculations for Exterior Columns with Two Beams Framing into them in the Direction of Analysis

$$P_{c2} = \frac{\pi^2 \times 27.5 \times 10^6}{(1.71 \times 13.333 \times 12)^2} = 3,621 \text{ kip}$$

For interior columns (8 columns):

$$I_{column} = 0.7 \times \frac{c^4}{12} = 0.7 \times \frac{24^4}{12} = 19,354 \text{ in.}^4$$

ACI 318-14 (Table 6.6.3.1.1(a))

$$E_c = 57,000 \times \sqrt{f'_c} = 57,000 \times \sqrt{6000} = 4,415 \text{ ksi}$$

ACI 318-14 (19.2.2.1.a)

For the column below level 2:

$$\frac{E_c \times I_{column}}{l_c} = \frac{4,415 \times 19,354}{15 - 20/2} = 503 \times 10^3 \text{ in.kip}$$

For the column above level 2:

$$\frac{E_c \times I_{column}}{l_c} = \frac{4,415 \times 19,354}{12} = 593 \times 10^3 \text{ in.kip}$$

For beams framing into the columns:

$$\frac{E_b \times I_{beam}}{l_b} = \frac{3,605 \times 5,600}{24} = 70 \times 10^3 \text{ in.kip}$$

Where:

$$E_b = 57,000 \times \sqrt{f'_c} = 57,000 \times \sqrt{4000} = 3,605 \text{ ksi}$$

ACI 318-14 (19.2.2.1.a)

$$I_{beam} = 0.35 \times \frac{b \times h^4}{12} = 0.35 \times \frac{24 \times 20^4}{12} = 5,600 \text{ in.}^4$$

ACI 318-14 (Table 6.6.3.1.1(a))

$$\Psi_A = \frac{\left(\sum \frac{EI}{l_c} \right)_{columns}}{\left(\sum \frac{EI}{l} \right)_{beams}} = \frac{503 + 593}{70 + 70} = 7.8$$

ACI 318-14 (Figure R6.2.5)

$$\Psi_B = 1.0 \text{ (Column essentially fixed at base)}$$

ACI 318-14 (Figure R6.2.5)

Using Figure R6.2.5 from ACI 318-14 $\rightarrow k = 1.81$ as shown in the figure below for the interior columns.

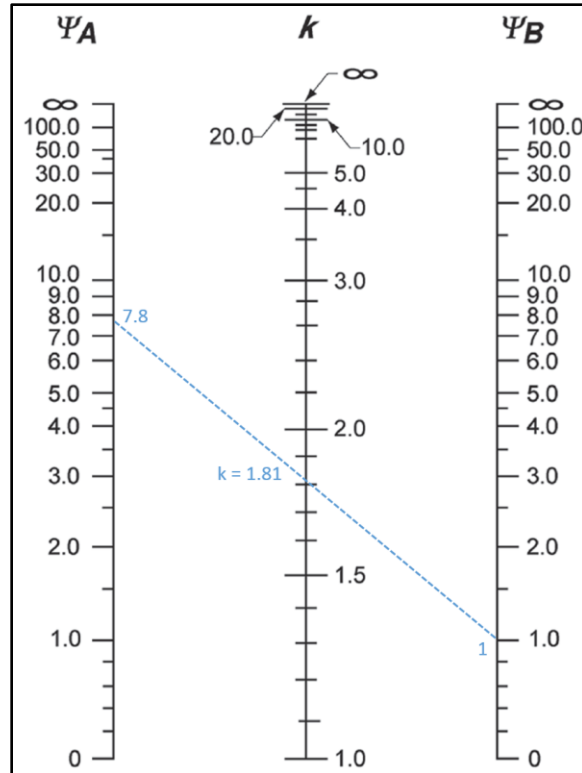


Figure 4 – Effective Length Factor (k) Calculations for Interior Columns

With 8-#8 reinforcement equally distributed on all sides and 24 in. x 24 in. column section $\rightarrow I_{se} = 439.1 \text{ in.}^4$.

$$(EI)_{eff} = \frac{0.2E_c I_g + E_s I_{se}}{1 + \beta_{ds}} \quad \text{ACI 318-14 (6.6.4.4.4(b))}$$

$$(EI)_{eff} = \frac{0.2 \times 4,415 \times 27,648 + 29,000 \times 439.1}{1 + 0} = 37.1 \times 10^6 \text{ kip-in.}^2$$

$$P_{c3} = \frac{\pi^2 \times 37.1 \times 10^6}{(1.81 \times 13.333 \times 12)^2} = 4,372 \text{ kip}$$

$$\Sigma P_c = n_1 \times P_{c1} + n_2 \times P_{c2} + n_3 \times P_{c3}$$

$$\Sigma P_c = 12 \times 2,933 + 4 \times 3,621 + 8 \times 4,372 = 84,652 \text{ kip}$$

For load combination 4:

$$\Sigma P_u = 1.2 \times D + 1.6 \times L_r = 1.2 \times 17,895 + 1.6 \times 270 = 21,906 \text{ kip} \quad \text{ASCE 7-10 (2.3.2-3)}$$

$$\delta_s = \frac{1}{1 - \frac{\Sigma P_u}{0.75 \times \Sigma P_c}} \quad \text{ACI 318-14 (6.6.4.6.2(b))}$$

$$\delta_s = \frac{1}{1 - \frac{21,906}{0.75 \times 84,652}} = 1.53$$

$$\delta_s M_{Top,s} = 1.53 \times 13.7 = 20.9 \text{ ft.kip}$$

$$M_{Top_2^{nd}} = M_{Top,ns} + \delta_s M_{Top,s} = 41.8 + 20.9 = 62.7 \text{ ft.kip} \quad \text{ACI 318-14 (6.6.4.6.1)}$$

$$\delta_s M_{Bottom,s} = 1.53 \times 110.4 = 168.6 \text{ ft.kip}$$

$$M_{Bottom_2^{nd}} = M_{Bottom,ns} + \delta_s M_{Bottom,s} = 21.1 + 168.6 = 189.7 \text{ ft.kip} \quad \text{ACI 318-14 (6.6.4.6.1)}$$

$$M_{2_2^{nd}} = \max(M_{Top_2^{nd}}, M_{Bottom_2^{nd}}) = M_{Bottom_2^{nd}} = 189.7 \text{ ft.kip} \rightarrow M_{2_1^{st}} = M_{Bottom_1^{st}} = 131.5 \text{ ft.kip}$$

$$M_{1_2^{nd}} = \min(M_{Top_2^{nd}}, M_{Bottom_2^{nd}}) = M_{Top_2^{nd}} = 62.7 \text{ ft.kip} \rightarrow M_{1_1^{st}} = M_{Top_1^{st}} = 55.4 \text{ ft.kip}$$

$$P_u = 722.0 \text{ kip}$$

A summary of the moment magnification factors and magnified moments for the exterior column for all load combinations using both equation options ACI 318-14 (6.6.4.4.4(a)) and (6.6.4.4.4(b)) to calculate $(EI)_{eff}$ is provided in the table below for illustration and comparison purposes. Note: The designation of M_1 and M_2 is made based on the second-order (magnified) moments and not based on the first-order (unmagnified) moments.

No.	Load Combination	Axial Load, kip	Using ACI 6.6.4.4.4(a)			Using ACI 6.6.4.4.4(b)		
			δ_s	M_1 , ft-kip	M_2 , ft-kip	δ_s	M_1 , ft-kip	M_2 , ft-kip
1	1.4D	871.4	---	24.6	48.7	---	24.6	48.7
2	1.2D + 1.6L + 0.5L _r	869.4	---	33.4	66.4	---	33.4	66.4
3	1.2D + 0.5L + 1.6 L _r	797.6	---	25.0	49.5	---	25.0	49.5
4	1.2D + 1.6L _r + 0.8W	722.0	1.37	60.6	172.3	1.53	62.7	189.7
5	1.2D + 1.6L _r - 0.8W	799.3	1.37	23.0	-130.1	1.53	20.9	-147.5
6	1.2D + 0.5L + 0.5L _r + 1.6W	710.9	1.39	87.5	330.9	1.55	92.0	367.9
7	1.2D + 0.5L + 0.5L _r - 1.6W	865.4	1.39	11.5	-280.9	1.55	7.0	-317.9
8	0.9D + 1.6W	482.9	1.25	65.5	291.2	1.34	68.0	311.6
9	0.9D - 1.6W	637.4	1.25	-2.9	-259.6	1.34	-5.4	-280.0

5. Moment Magnification along Length of Compression Member

In sway frames, second-order effects shall be considered along the length of columns. It shall be permitted to account for these effects using ACI 318-14 (6.6.4.5) (Nonsway frame procedure), where C_m is calculated using M_1 and M_2 from ACI 318-14 (6.6.4.6.1) as follows: ACI 318-14 (6.6.4.6.4)

$$M_{c2} = \delta M_2 \quad \text{ACI 318-14 (6.6.4.5.1)}$$

Where:

M_2 = the second-order factored moment.

$$\delta = \text{magnification factor} = \frac{C_m}{1 - \frac{P_u}{0.75P_c}} \geq 1.0 \quad \text{ACI 318-14 (6.6.4.5.2)}$$

$$P_c = \frac{\pi^2 (EI)_{eff}}{(kl_u)^2} \quad \text{ACI 318-14 (6.6.4.4.2)}$$

Where:

$$(EI)_{eff} = \left\{ \begin{array}{l} \text{(a) } \frac{0.4E_c I_g}{1 + \beta_{dns}} \\ \text{(b) } \frac{0.2E_c I_g + E_s I_{se}}{1 + \beta_{dns}} \\ \text{(c) } \frac{E_c I}{1 + \beta_{dns}} \end{array} \right\} \quad \text{ACI 318-14 (6.6.4.4.4)}$$

There are three options for calculating the effective flexural stiffness of slender concrete columns $(EI)_{eff}$. The second equation provides accurate representation of the reinforcement in the section and will be used in this example and is also used by the solver in [spColumn](#). Further comparison of the available options is provided in “[Effective Flexural Stiffness for Critical Buckling Load of Concrete Columns](#)” technical note.

$$I_{column} = \frac{c^4}{12} = \frac{22^4}{12} = 19,521 \text{ in.}^4 \quad \text{ACI 318-14 (Table 6.6.3.1.1(a))}$$

$$E_c = 57,000 \times \sqrt{f'_c} = 57,000 \times \sqrt{6000} = 4,415 \text{ ksi} \quad \text{ACI 318-14 (19.2.2.1.a)}$$

β_{dns} is the ratio of maximum factored sustained axial load to maximum factored axial load associated with the same load combination. ACI 318-14 (6.6.4.4.4)

For load combination 4:

$$P_{u,sustained} = 1.2 \times 622.4 = 746.9 \text{ kip}$$

$$P_u = 1.2 \times 622.4 + 1.6 \times 8.6 + 0.8 \times -48.3 = 722 \text{ kip}$$

$$\beta_{dns} = \frac{P_{u,sustained}}{P_u} = \frac{746.9}{722} = 1.03 > 1.00 \rightarrow \therefore \beta_{dns} = 1.0$$

$$\Psi_A = \frac{\left(\sum \frac{EI}{l_c} \right)_{columns}}{\left(\sum \frac{EI}{l} \right)_{beams}} = \frac{355 + 419}{70} = 11 \text{ (Calculated previously)}$$

ACI 318-14 (Figure R6.2.5)

$$\Psi_B = 1.0 \text{ (Column essentially fixed at base)}$$

ACI 318-14 (Figure R6.2.5)

Using Figure R6.2.5(a) from ACI 318-14 $\rightarrow k = 0.86$ as shown in the figure below for the exterior column.

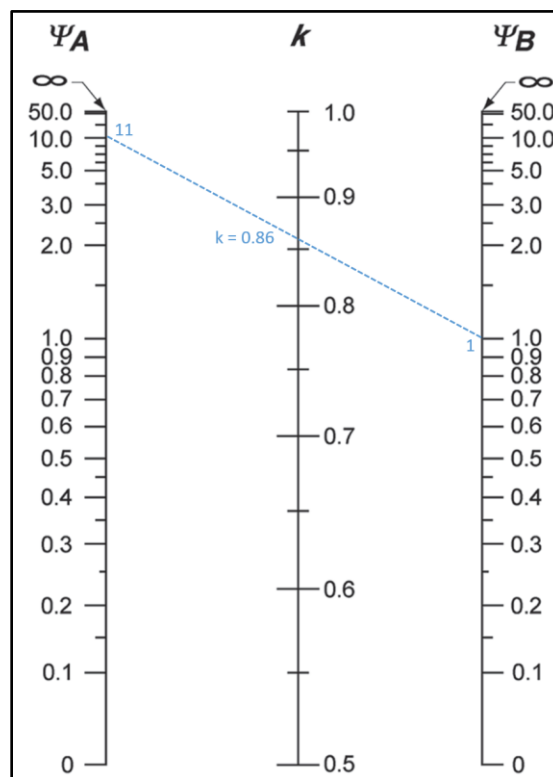


Figure 5 – Effective Length Factor (k) Calculations for Exterior Column (Nonsway)

With 8-#8 reinforcement equally distributed on all sides and 22 in. x 22 in. column section $\rightarrow I_{se} = 352.6 \text{ in.}^4$.

$$(EI)_{eff} = \frac{0.2E_c I_g + E_s I_{se}}{1 + \beta_{dns}}$$

ACI 318-14 (6.6.4.4.4(b))

$$(EI)_{eff} = \frac{0.2 \times 4,415 \times 19,521 + 29,000 \times 352.6}{1 + 1} = 13.7 \times 10^6 \text{ kip-in.}^2$$

$$P_c = \frac{\pi^2 \times 13.7 \times 10^6}{(0.86 \times 13.333 \times 12)^2} = 7,158 \text{ kip}$$

For load combination 4:

$$P_u = 1.2 \times 622.4 + 1.6 \times 8.6 + 0.8 \times -48.3 = 722 \text{ kip} \quad \text{ASCE 7-10 (2.3.2-3)}$$

$$C_m = 0.6 + 0.4 \frac{M_1}{M_2} \quad \text{ACI 318-14 (6.6.4.5.3a)}$$

$$M_2 = M_{2_{2^{nd}}} = 189.7 \text{ ft.kip (as concluded from section 4)} \quad \text{ACI 318-14 (6.6.4.6.4)}$$

$$M_1 = M_{1_{2^{nd}}} = 62.7 \text{ ft.kip (as concluded from section 4)} \quad \text{ACI 318-14 (6.6.4.6.4)}$$

Since the column is bent in double curvature, M_1/M_2 is positive. ACI 318-14 (6.6.4.5.3)

$$C_m = 0.6 - 0.4 \left(\frac{62.7}{189.7} \right) = 0.468$$

$$\delta = \frac{C_m}{1 - \frac{P_u}{0.75 P_c}} \geq 1.0 \quad \text{ACI 318-14 (6.6.4.5.2)}$$

$$\delta = \frac{0.468}{1 - \frac{722}{0.75 \times 7,158}} = 0.54 < 1.00 \rightarrow \delta = 1.00$$

$$M_{\min} = P_u (0.6 + 0.03h) \quad \text{ACI 318-14 (6.6.4.5.4)}$$

Where $P_u = 722$ kip, and $h =$ the section dimension in the direction being considered = 22 in.

$$M_{\min} = 722 \left(\frac{0.6 + 0.03 \times 22}{12} \right) = 75.81 \text{ ft.kip}$$

$$M_1 = 62.70 \text{ ft.kip} < M_{\min} = 75.81 \text{ ft.kip} \rightarrow M_1 = 75.81 \text{ ft.kip} \quad \text{ACI 318-14 (6.6.4.5.4)}$$

$$M_{c1} = \delta M_1 \quad \text{ACI 318-14 (6.6.4.5.1)}$$

$$M_{c1} = 1.00 \times 75.81 = 75.81 \text{ ft.kip}$$

$$M_2 = 189.7 \text{ ft.kip} > M_{2,\min} = 75.81 \text{ ft.kip} \rightarrow M_2 = 189.7 \text{ ft.kip} \quad \text{ACI 318-14 (6.6.4.5.4)}$$

$$M_{c2} = \delta M_2 \quad \text{ACI 318-14 (6.6.4.5.1)}$$

$$M_{c2} = 1.00 \times 189.7 = 189.7 \text{ ft.kip}$$

M_{c1} and M_{c2} will be considered separately to ensure proper comparison of resulting magnified moments against negative and positive moment capacities of unsymmetrical sections as can be seen in the following figure.

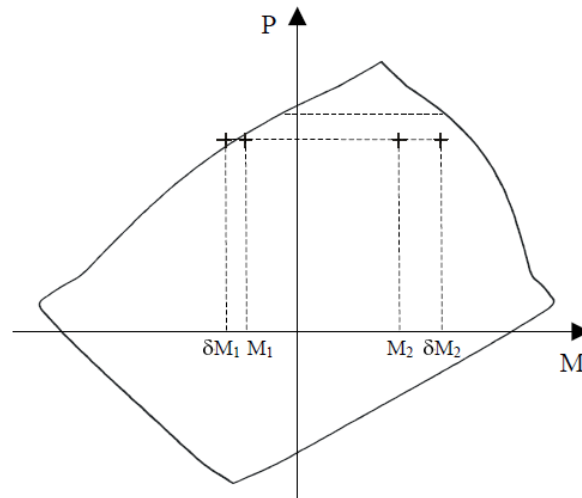


Figure 6 – Column Interaction Diagram for Unsymmetrical Section

A summary of the moment magnification factors and magnified moments for the exterior column for all load combinations using both equation options ACI 318-14 (6.6.4.4.4(a)) and (6.6.4.4.4(b)) to calculate $(EI)_{eff}$ is provided in the table below for illustration and comparison purposes.

Table 4 - Factored Axial loads and Magnified Moments along Exterior Column Length								
No.	Load Combination	Axial Load, kip	Using ACI 6.6.4.4.4(a)			Using ACI 6.6.4.4.4(b)		
			δ	M_{c1} , ft-kip	M_{c2} , ft-kip	δ	M_{c1} , ft-kip	M_{c2} , ft-kip
1	1.4D	871.4	1.00	91.5	91.5	1.00	91.5	91.5
2	1.2D + 1.6L + 0.5L _r	869.4	1.00	91.3	91.3	1.00	91.3	91.3
3	1.2D + 0.5L + 1.6L _r	797.6	1.00	83.7	83.7	1.00	83.7	83.7
4	1.2D + 1.6L _r + 0.8W	722.0	1.00	75.8	172.3	1.00	75.8	189.7
5	1.2D + 1.6L _r - 0.8W	799.3	1.00	83.9	-130.1	1.00	83.9	-147.5
6	1.2D + 0.5L + 0.5L _r + 1.6W	710.9	1.00	87.5	330.9	1.00	92.0	367.9
7	1.2D + 0.5L + 0.5L _r - 1.6W	865.4	1.00	90.9	-280.9	1.00	90.9	-317.9
8	0.9D + 1.6W	482.9	1.00	65.5	291.2	1.00	68.0	311.6
9	0.9D - 1.6W	637.4	1.00	66.9	-259.6	1.00	66.9	-280.0

For column design ACI 318 requires the second-order moment to first-order moment ratios should not exceed 1.40. If this value is exceeded, the column design needs to be revised. **ACI 318-14 (6.2.6)**

Table 5 - Second-Order Moment to First-Order Moment Ratios

No.	Load Combination	Using ACI 6.6.4.4(a)		Using ACI 6.6.4.4(b)	
		$M_{c1}/M_{1(1st)}$	$M_{c2}/M_{2(1st)}$	$M_{c1}/M_{1(1st)}$	$M_{c2}/M_{2(1st)}$
1	1.4D	1.00*	1.00*	1.00*	1.00*
2	1.2D + 1.6L + 0.5L _r	1.00*	1.00*	1.00*	1.00*
3	1.2D + 0.5L + 1.6 L _r	1.00*	1.00*	1.00*	1.00*
4	1.2D + 1.6L _r + 0.8W	1.00*	1.31	1.00*	1.40 < 1.44
5	1.2D + 1.6L _r - 0.8W	1.00*	1.40 < 1.46	1.00*	1.40 < 1.65
6	1.2D + 0.5L + 0.5L _r + 1.6W	1.14	1.35	1.20	1.40 < 1.50
7	1.2D + 0.5L + 0.5L _r - 1.6W	1.00*	1.40 < 1.43	1.00*	1.40 < 1.62
8	0.9D + 1.6W	1.12	1.23	1.16	1.32
9	0.9D - 1.6W	1.00*	1.27	1.00*	1.37

* Cutoff value of M_{min} is applied to $M_{1(1st)}$ and $M_{2(1st)}$ in order to avoid unduly large ratios in cases where $M_{1(1st)}$ and $M_{2(1st)}$ moments are smaller than M_{min} .

6. Column Design

Based on the factored axial loads and magnified moments considering slenderness effects, the capacity of the assumed column section (22 in. x 22 in. with 8-#8 bars distributed all sides equal) will be checked and confirmed to finalize the design. A column interaction diagram will be generated using strain compatibility analysis, the detailed procedure to develop column interaction diagram can be found in “[Interaction Diagram – Tied Reinforced Concrete Column](#)” example.

The axial compression capacity ϕP_n for all load combinations will be set equals to P_u , then the moment capacity ϕM_n associated to ϕP_n will be compared with the magnified applied moment M_u . The design check for load combination #4 is shown below for illustration. The rest of the checks for the other load combinations are shown in the following Table.

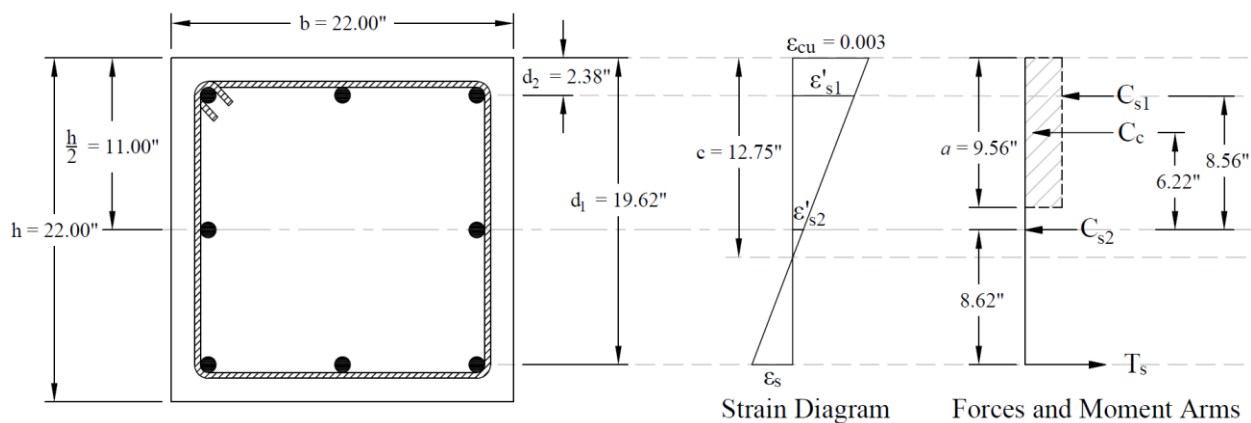


Figure 7 – Strains, Forces, and Moment Arms (Load Combination 4)

The following procedure is used to determine the nominal moment capacity by setting the design axial load capacity, ϕP_n , equal to the applied axial load, P_u and iterating on the location of the neutral axis.

6.1. c, a, and strains in the reinforcement

Try $c = 12.75$ in.

Where c is the distance from the fiber of maximum compressive strain to the neutral axis.

ACI 318-14 (22.2.2.4.2)

$$a = \beta_1 \times c = 0.75 \times 12.75 = 9.563 \text{ in.}$$

ACI 318-14 (22.2.2.4.1)

Where:

$$\beta_1 = 0.85 - \frac{0.05 \times (f'_c \times 4000)}{1000} = 0.85 - \frac{0.05 \times (6000 \times 4000)}{1000} = 0.75$$

ACI 318-14 (Table 22.2.2.4.3)

$$\varepsilon_{cu} = 0.003$$

ACI 318-14 (22.2.2.1)

$$\varepsilon_y = \frac{f_y}{E_s} = \frac{60}{29,000} = 0.00207$$

$$\varepsilon_s = (d_1 - c) \times \frac{0.003}{c} = (19.625 - 12.75) \times \frac{0.003}{12.75} = 0.00162 \text{ (Tension)} < \varepsilon_y$$

∴ tension reinforcement has not yielded

$$\therefore \phi = 0.65$$

ACI 318-14 (Table 21.2.2)

$$\varepsilon'_{s1} = (c - d_2) \times \frac{0.003}{c} = (12.75 - 2.375) \times \frac{0.003}{12.75} = 0.00244 \text{ (Compression)} > \varepsilon_y$$

$$\varepsilon'_{s2} = \left(c - \frac{h}{2}\right) \times \frac{0.003}{c} = (12.75 - 11) \times \frac{0.003}{12.75} = 0.00041 \text{ (Compression)} < \varepsilon_y$$

6.2. Forces in the concrete and steel

$$C_c = 0.85 \times f'_c \times a \times b = 0.85 \times 6,000 \times 9.563 \times 22 = 1073 \text{ kip}$$

ACI 318-14 (22.2.2.4.1)

$$f_s = \varepsilon_s \times E_s = 0.00162 \times 29,000,000 = 46,912 \text{ psi}$$

$$T_s = f_y \times A_{s1} = 46,912 \times (3 \times 0.79) = 111.2 \text{ kip}$$

Since $\varepsilon'_{s1} > \varepsilon_y \rightarrow$ compression reinforcement has yielded

$$\therefore f'_{s1} = f_y = 60,000 \text{ psi}$$

Since $\varepsilon'_{s2} < \varepsilon_y \rightarrow$ compression reinforcement has not yielded

$$\therefore f'_{s2} = \varepsilon'_{s2} \times E_s = 0.00041 \times 29,000,000 = 11,941 \text{ psi}$$

The area of the reinforcement in this layer has been included in the area (ab) used to compute C_c . As a result, it is necessary to subtract $0.85f'_c$ from f'_s before computing C_s :

$$C_{s1} = (f'_{s1} - 0.85f'_c) \times A'_{s1} = (60,000 - 0.85 \times 6,000) \times (3 \times 0.79) = 130.1 \text{ kip}$$

$$C_{s2} = (f'_{s2} - 0.85f'_c) \times A'_{s2} = (11,941 - 0.85 \times 6,000) \times (2 \times 0.79) = 18.9 \text{ kip}$$

6.3. ϕP_n and ϕM_n

$$P_n = C_c + C_{s1} + C_{s2} - T_s = 1,073 + 130.1 + 18.9 - 111.2 = 1,111 \text{ kip}$$

$$\phi P_n = 0.65 \times 1,111 = 722 \text{ kip} = P_u$$

The assumption that $c = 12.75$ in. is correct

$$M_n = C_c \times \left(\frac{h}{2} - \frac{a}{2} \right) + C_{s1} \times \left(\frac{h}{2} - d_2 \right) + C_{s2} \times \left(\frac{h}{2} - \frac{h}{2} \right) + T_s \times \left(d_1 - \frac{h}{2} \right)$$

$$M_n = 1,073 \times \left(\frac{22}{2} - \frac{9.563}{2} \right) + 130.1 \times \left(\frac{22}{2} - 2.375 \right) + 18.9 \times \left(\frac{22}{2} - \frac{22}{2} \right) + 111.2 \times \left(19.625 - \frac{22}{2} \right) = 729 \text{ kip.ft}$$

$$\phi M_n = 0.65 \times 729 = 474 \text{ kip.ft} < M_u = M_{c2} = 189.7 \text{ kip.ft}$$

Table 6 – Exterior Column Axial and Moment Capacities

No.	P_u , kip	$M_u = M_{2(\text{nd})}$, ft-kip	c, in.	$\epsilon_t = \epsilon_s$	ϕ	ϕP_n , kip	ϕM_n , kip.ft
1	871.4	91.5	14.85	0.00096	0.65	871.4	459.4
2	869.4	91.3	14.85	0.00097	0.65	869.4	459.7
3	797.6	83.7	13.75	0.00128	0.65	797.6	468.2
4	722.0	189.7	12.75	0.00162	0.65	722.0	474.1
5	799.3	-147.5	13.78	0.00127	0.65	799.3	468.0
6	710.9	367.9	12.61	0.00167	0.65	710.9	474.8
7	865.4	-317.9	14.76	0.00099	0.65	865.4	460.2
8	482.9	311.6	7.36	0.005	0.9	482.9	557.2
9	637.4	-280.0	11.68	0.00204	0.65	637.4	478.8

Therefore, since $\phi M_n > M_u$ for all $\phi P_n = P_u$, use 22 x 22 in. column with 8-#8 bars.

7. Column Interaction Diagram - spColumn Software

spColumn program performs the analysis of the reinforced concrete section conforming to the provisions of the Strength Design Method and Unified Design Provisions with all conditions of strength satisfying the applicable conditions of equilibrium and strain compatibility and includes slenderness effects using moment magnification method for sway and nonsway frames. For this column section, we ran in investigation mode with control points using the 318-14. In lieu of using program shortcuts, spSection (Figure 8) was used to place the reinforcement and define the cover to illustrate handling of irregular shapes and unusual bar arrangement.

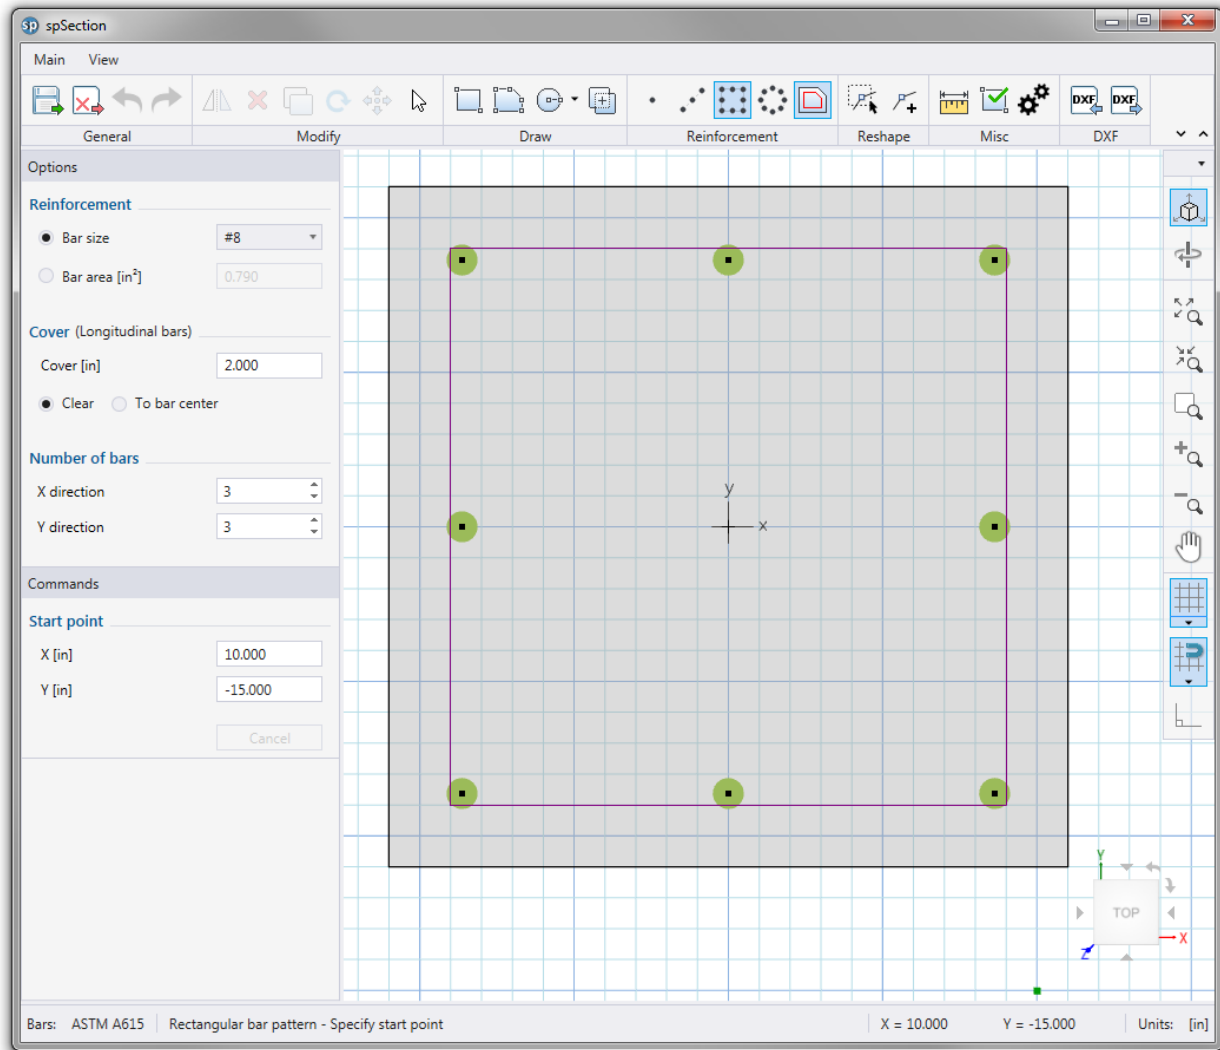


Figure 8 – spColumn Model Editor (spSection)

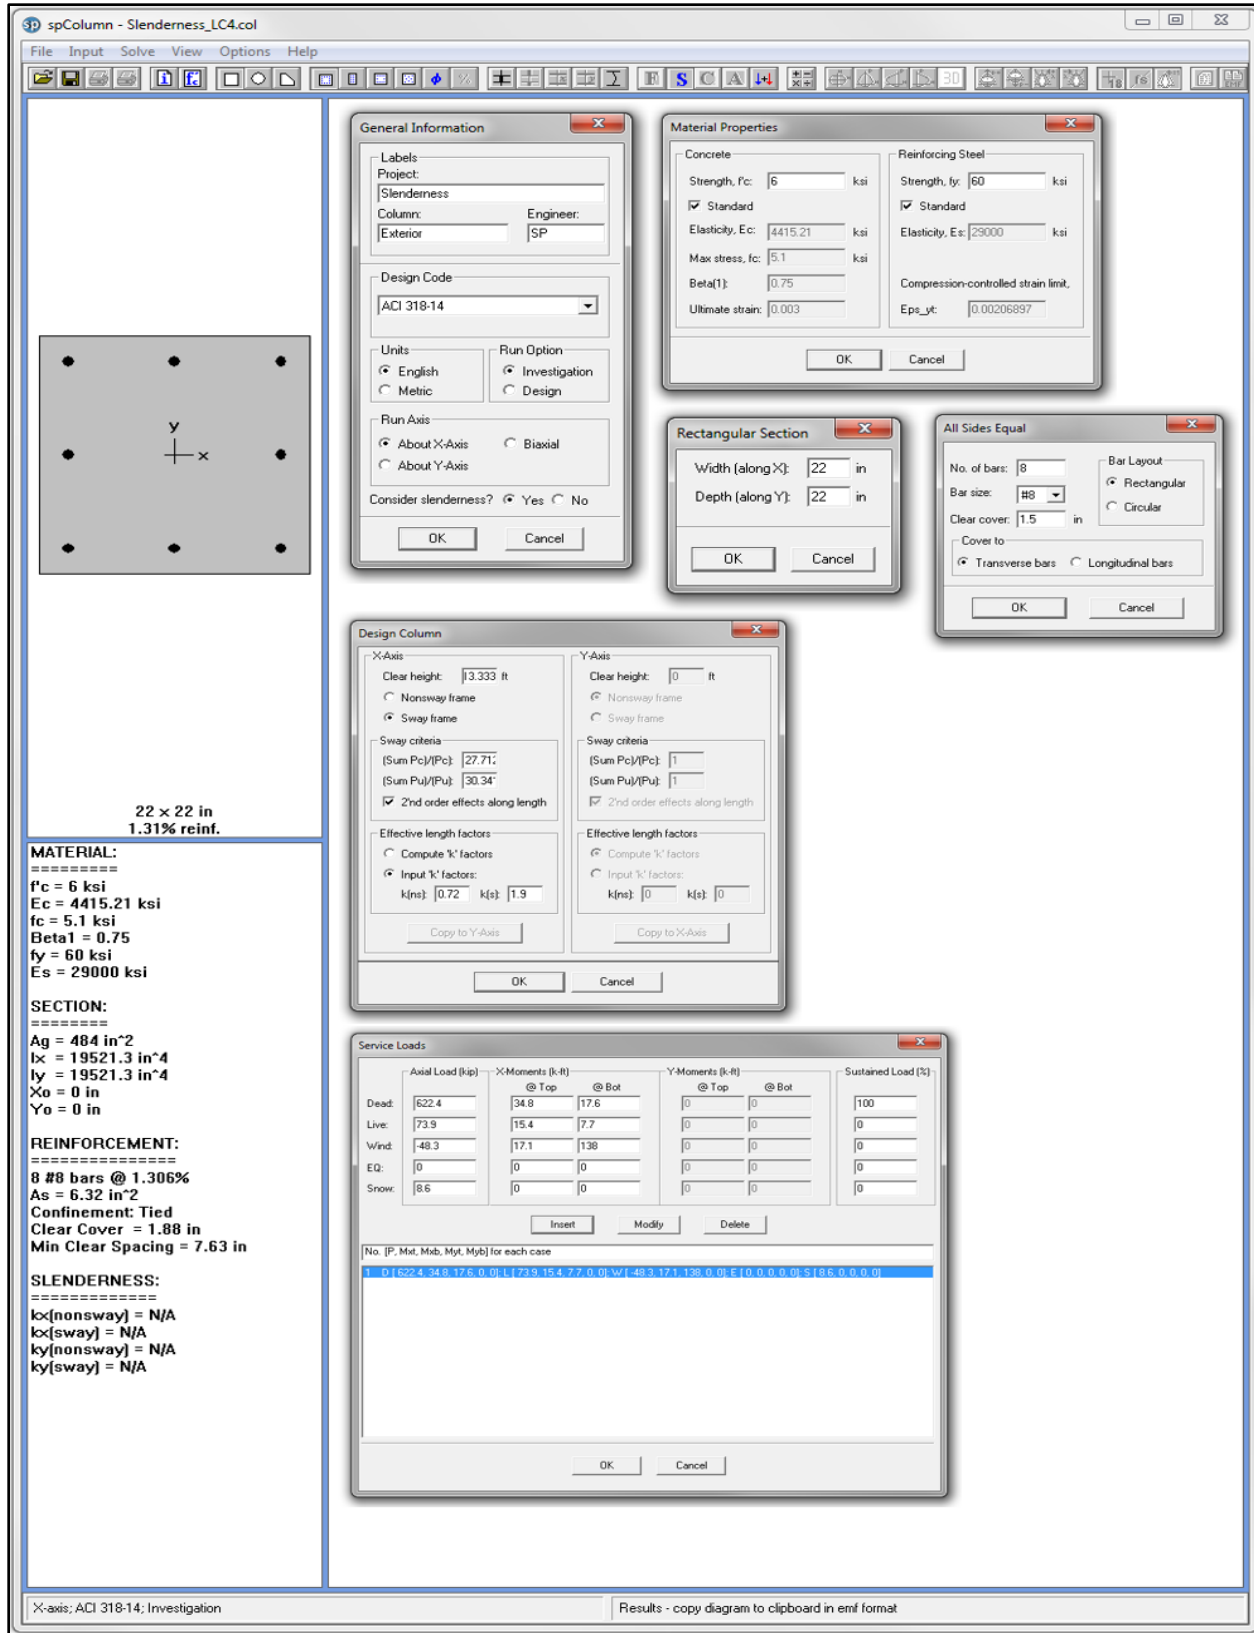


Figure 9 – spColumn Model Input Wizard Windows


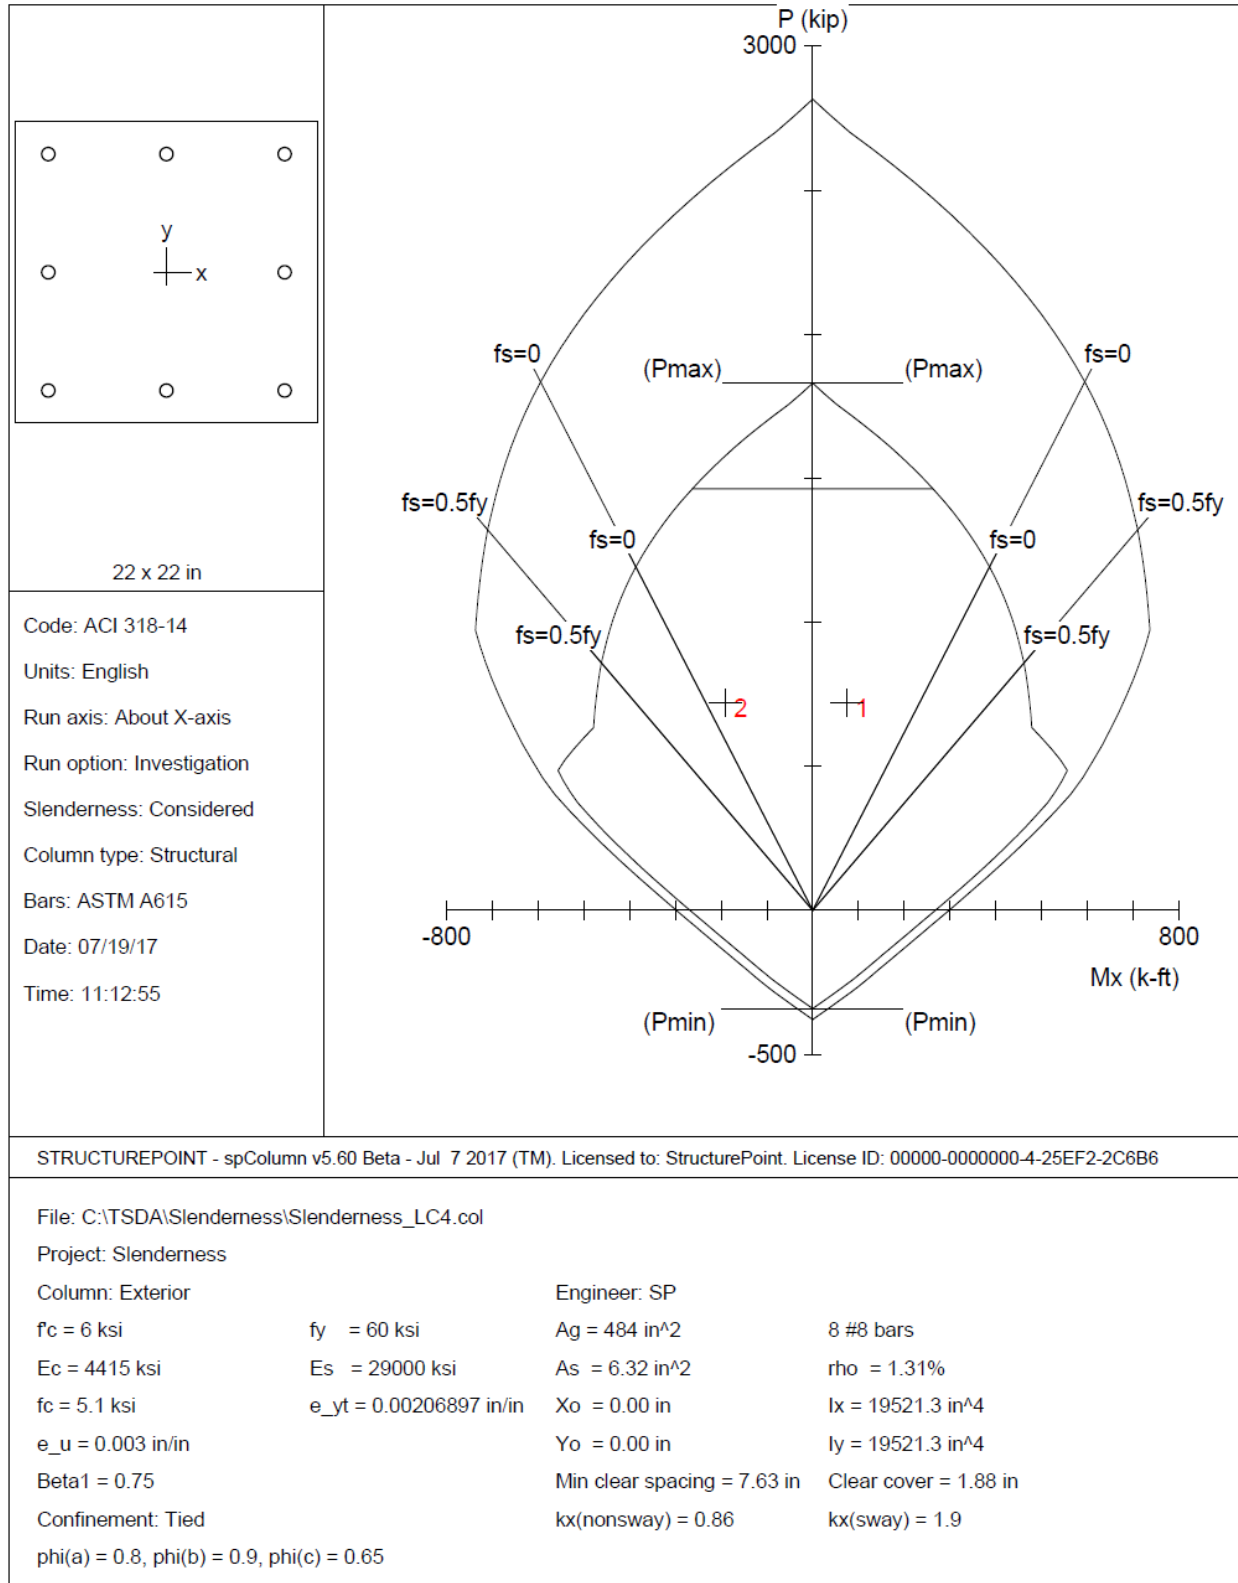


Figure 10 – Column Section Interaction Diagram about the X-Axis – Design Check for Load Combination 4 (spColumn)



spColumn v5.60 Beta - Jul 7 2017
Computer program for the Strength Design of Reinforced Concrete Sections
Copyright - 1988-2017, STRUCTUREPOINT, LLC.
All rights reserved

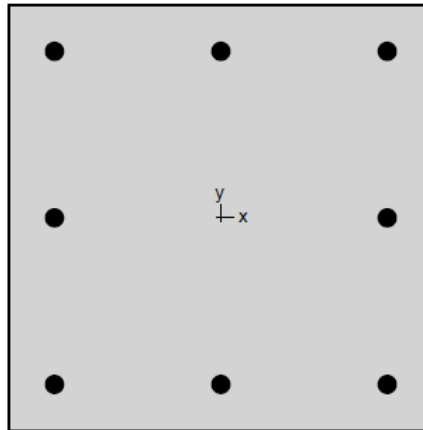

Contents

1. General Information.....	3
2. Material Properties.....	3
2.1. Concrete.....	3
2.2. Steel.....	3
3. Section.....	3
3.1. Shape and Properties.....	3
3.2. Section Figure.....	4
4. Reinforcement.....	4
4.1. Bar Set: ASTM A615.....	4
4.2. Confinement and Factors.....	4
4.3. Arrangement.....	4
5. Loading.....	5
5.1. Load Combinations.....	5
5.2. Service Loads.....	5
5.3. Sustained Load Factors.....	5
6. Slenderness.....	5
6.1. Sway Criteria.....	5
6.2. Columns.....	5
6.3. X - Beams.....	5
7. Moment Magnification.....	6
7.1. General Parameters.....	6
7.2. Effective Length Factors.....	6
7.3. Magnification Factors: X - axis.....	6
8. Factored Moments.....	6
8.1. X - axis.....	6
9. Factored Loads and Moments with Corresponding Capacities.....	6

List of Figures

Figure 1: Column section.....	4
-------------------------------	---

1. General Information

File Name	C:\TSDA\Slenderness\Slenderness_LC4.col
Project	Slenderness
Column	Exterior
Engineer	SP
Code	ACI 318-14
Bar Set	ASTM A615
Units	English
Run Option	Investigation
Run Axis	X - axis
Slenderness	Considered
Column Type	Structural

2. Material Properties

2.1. Concrete

Type	Standard
f_c	6 ksi
E_c	4415.21 ksi
f_c	5.1 ksi
ϵ_u	0.003 in/in
β_1	0.75

2.2. Steel

Type	Standard
f_y	60 ksi
E_s	29000 ksi
ϵ_{yt}	0.00206897 in/in

3. Section

3.1. Shape and Properties

Type	Rectangular
Width	22 in
Depth	22 in
A_g	484 in ²
I_x	19521.3 in ⁴
I_y	19521.3 in ⁴
r_x	6.35085 in
r_y	6.35085 in
X_o	0 in
Y_o	0 in

3.2. Section Figure

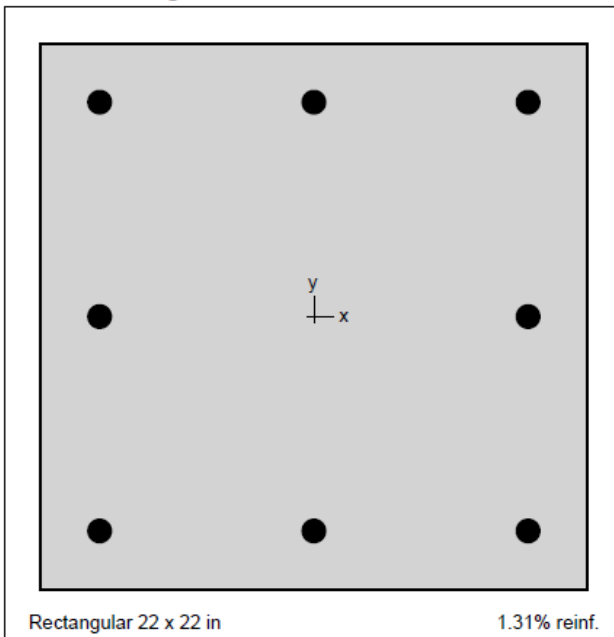


Figure 1: Column section

4. Reinforcement

4.1. Bar Set: ASTM A615

Bar	Diameter in	Area in ²	Bar	Diameter in	Area in ²	Bar	Diameter in	Area in ²
#3	0.38	0.11	#4	0.50	0.20	#5	0.63	0.31
#6	0.75	0.44	#7	0.88	0.60	#8	1.00	0.79
#9	1.13	1.00	#10	1.27	1.27	#11	1.41	1.56
#14	1.69	2.25	#18	2.26	4.00			

4.2. Confinement and Factors

Confinement type	Tied
For #10 bars or less	#3 ties
For larger bars	#4 ties
Axial compression, (a)	0.8
Tension controlled failure, (b)	0.9
Compression controlled failure, (c)	0.65

4.3. Arrangement

Pattern	All sides equal
Bar layout	Rectangular
Cover to	Transverse bars
Cover	1.5 in
Bars	8 #8

Total steel area, A_s	6.32 in ²
rho	1.31 %
Minimum clear spacing	7.63 in

5. Loading

5.1. Load Combinations

Combination	Dead	Live	Wind	EQ	Snow
U1	1.200	0.000	0.800	0.000	1.600

5.2. Service Loads

No	Load case	Axial load kip	Mx @ Top k-ft	Mx @ Bottom k-ft	My @ Top k-ft	My @ Bottom k-ft
1	Dead	622.40	34.80	17.60	0.00	0.00
1	Live	73.90	15.40	7.70	0.00	0.00
1	Wind	-48.30	17.10	138.00	0.00	0.00
1	EQ	0.00	0.00	0.00	0.00	0.00
1	Snow	8.60	0.00	0.00	0.00	0.00

5.3. Sustained Load Factors

Load case	Factor %
Dead	100
Live	0
Wind	0
EQ	0
Snow	0

6. Slenderness

6.1. Sway Criteria

X-Axis	Sway column
2 nd order effects along length	Considered
$\sum P_c$	28.86 x P_c
$\sum P_u$	30.34 x P_u

6.2. Columns

Column	Axis	Height ft	Width in	Depth in	I in ⁴	f'_c ksi	E_c ksi	
Design	X	13.333	22	22	19521.3	6	4415.21	
Above	X	10.333	22	22	19521.3	6	4415.21	
Below	X	(no column specified...)						

6.3. X - Beams

Beam	Length ft	Width in	Depth in	I in ⁴	f'_c ksi	E_c ksi
Above Left	24	24	20	16000	6	4415.21
Above Right	24	24	20	16000	6	4415.21
Below Left	(no beam specified...)					
Below Right	(no beam specified...)					

7. Moment Magnification

7.1. General Parameters

Factors	Code defaults
Stiffness reduction factor, Φ_k	0.75
Cracked section coefficients, c1(beams)	0.35
Cracked section coefficients, c1(columns)	0.7
0.2 $E_c I_g + E_s I_{se}$ (X-axis)	2.75e+007 kip-in ²
Minimum eccentricity, $E_{x\ min}$	1.26 in

7.2. Effective Length Factors

Axis	Ψ_{top}	Ψ_{bottom}	k (Nonsway)	k (Sway)	kl_u/r
X	0.000	0.000	0.860	1.900	47.87

7.3. Magnification Factors: X - axis

Load Combo	At Ends					Along Length					
	$\sum P_u$ kip	P_c kip	$\sum P_c$ kip	β_{ds}	Δ_s	P_u kip	kl_u/r	P_c kip	β_d	C_m	Δ
1 U1	21906.20	2933.16	84656.99	0.000	1.527	722.00	(N/A)	7158.41	1.000	0.468	1.000

8. Factored Moments

NOTE: Each loading combination includes the following cases:
Top - At column top
Bot - At column bottom

8.1. X - axis

Load Combo	1 st Order				2 nd Order			Ratio 2 nd /1 st
	M_{ns} k-ft	M_s k-ft	M_u k-ft	M_{min} k-ft	M_1 k-ft	M_c k-ft		
1 U1 Top	41.76	13.68	55.44	75.81	$M_1 =$ 62.65	75.81	1.000	
1 U1 Bot	-21.12	-110.40	-131.52	-75.81	$M_2 =$ -189.67	-189.67	1.442 *	

* Magnified (second-order) moment exceeds 1.4 times first-order moment. Revise design!

9. Factored Loads and Moments with Corresponding Capacities

NOTE: Each loading combination includes the following cases:
Top - At column top
Bot - At column bottom

No.	Load			P_u kip	M_{ux} k-ft	ΦM_{nx} k-ft	$\Phi M_n / M_u$	NA Depth in	Dt Depth in	ϵ_t	Φ
1	1	U1	Top	722.00	75.81	474.14	6.254	12.75	19.63	0.00162	0.650
2	1	U1	Bot	722.00	-189.67	-474.14	2.500	12.75	19.63	0.00162	0.650

8. Summary and Comparison of Design Results

Table 7 - Factored Axial loads and Magnified Moments at Column Ends Comparison

No.	P_u , kip			δ_s			$M_{1(2nd)}$, ft-kip			$M_{2(2nd)}$, ft-kip		
	Hand	Reference	spColumn	Hand	Reference	spColumn	Hand	Reference	spColumn	Hand	Reference*	spColumn
1	871.4	871.4	871.4	N/A	N/A	N/A	24.6	24.6	24.6	48.7	48.7	48.7
2	869.4	869.4	869.4	N/A	N/A	N/A	33.4	33.4	33.4	66.4	66.4	66.4
3	797.6	797.6	797.6	N/A	N/A	N/A	25.0	25.0	25.0	49.5	49.5	49.5
4	722.0	722.0	722.0	1.53	1.38	1.53	62.7	60.6	62.7	189.7	173.5	189.7
5	799.3	799.3	799.3	1.53	1.38	1.53	20.9	23.0	20.9	-147.5	-131.3	-147.4
6	710.9	710.9	7110.9	1.55	1.39	1.55	92.0	87.5	92.0	367.9	331.9	367.8
7	865.4	865.4	865.4	1.55	1.39	1.55	7.0	11.5	7.0	-317.9	-281.9	-317.9
8	482.9	482.9	482.9	1.34	1.25	1.34	68.0	65.5	68.0	311.6	292.0	311.7
9	637.4	637.4	637.4	1.34	1.25	1.34	-5.4	-2.9	-5.3	-280.0	-260.3	280.0

Table 8 - Magnified Moments along Column Length to First-Order Moment Ratios Comparison

No.	δ			M_{c1} , ft-kip			M_{c2} , ft-kip			$M_{c1}/M_{1(1st)}$			$M_{c2}/M_{2(1st)}$		
	Hand	Reference*	spColumn	Hand	Reference*	spColumn	Hand	Reference*	spColumn	Hand	Reference*	spColumn	Hand	Reference*	spColumn
1	1.00	---	1.00	91.5	---	91.5	91.5	---	91.5	1.00	---	1.00	1.00	---	1.00
2	1.00	---	1.00	91.3	---	91.3	91.3	---	91.3	1.00	---	1.00	1.00	---	1.00
3	1.00	---	1.00	83.7	---	83.7	83.7	---	83.7	1.00	---	1.00	1.00	---	1.00
4	1.00	---	1.00	75.8	---	75.8	189.7	---	189.7	1.00	---	1.00	1.44	---	1.44
5	1.00	---	1.00	83.9	---	83.9	-147.5	---	-147.4	1.00	---	1.00	1.65	---	1.65
6	1.00	---	1.00	92.0	---	92.0	367.9	---	367.8	1.20	---	1.20	1.50	---	1.50
7	1.00	---	1.00	90.9	---	90.9	-317.9	---	-317.9	1.00	---	1.00	1.62	---	1.62
8	1.00	---	1.00	68.0	---	68.0	311.6	---	311.7	1.16	---	1.16	1.32	---	1.32
9	1.00	---	1.00	-66.9	---	-66.9	-280.0	---	280.0	1.00	---	1.00	1.37	---	1.37

* Moment magnification along the length of the column is not covered by the reference

Table 9 - Design Parameters Comparison

No.	c, in.			$\epsilon_t = \epsilon_s$			ϕ			ϕP_n , kip			ϕM_n , kip.ft		
	Hand	Reference*	spColumn	Hand	Reference*	spColumn	Hand	Reference*	spColumn	Hand	Reference*	spColumn	Hand	Reference*	spColumn
1	14.85	14.85	14.85	0.00096	0.00096	0.00096	0.65	0.65	0.65	871.4	871.4	871.4	459.4	459.4	459.4
2	14.85	14.82	14.85	0.00097	0.00097	0.00097	0.65	0.65	0.65	869.4	869.4	869.4	459.7	459.7	459.7
3	13.75	13.75	13.75	0.00128	0.00128	0.00128	0.65	0.65	0.65	797.6	797.6	797.6	468.2	468.2	468.2
4	12.75	12.75	12.75	0.00162	0.00162	0.00162	0.65	0.65	0.65	722.0	722.0	722.0	474.1	474.1	474.1
5	13.78	13.78	13.78	0.00127	0.00127	0.00127	0.65	0.65	0.65	799.3	799.3	799.3	468.0	468.0	468.0
6	12.61	12.61	12.61	0.00167	0.00167	0.00167	0.65	0.65	0.65	710.9	710.9	7110.9	474.8	474.8	474.8
7	14.76	14.76	14.76	0.00099	0.00099	0.00099	0.65	0.65	0.65	865.4	865.4	865.4	460.2	460.2	460.2
8	7.36	7.36	7.36	0.00500	0.00500	0.00500	0.90	0.90	0.90	482.9	482.9	482.9	557.2	557.2	557.2
9	11.68	11.68	11.68	0.00204	0.00204	0.00204	0.65	0.65	0.65	637.4	637.4	637.4	478.8	478.8	478.8

* Notes on ACI 318-11 Building Code Requirements for Structural Concrete, Twelfth Edition, 2013 Portland Cement Association, Example 11-2

In all of the hand calculations and the reference used illustrated above, the results are in precise agreement with the automated exact results obtained from the [spColumn](#) program.

9. Conclusions & Observations

The analysis of the reinforced concrete section performed by [spColumn](#) conforms to the provisions of the Strength Design Method and Unified Design Provisions with all conditions of strength satisfying the applicable conditions of equilibrium and strain compatibility and includes slenderness effects using moment magnification method for sway and nonsway frames.

ACI 318 provides multiple options for calculating values of k , $(EI)_{eff}$, δ_s , and δ leading to variability in the determination of the adequacy of a column section. Engineers must exercise judgment in selecting suitable options to match their design condition as is the case in the reference where the author conservatively made assumptions to simplify and speed the calculation effort. The [spColumn](#) program utilizes the exact methods whenever possible and allows user to override the calculated values with direct input based on their engineering judgment wherever it is permissible.

In load combinations 4 to 7, M_u including second-order effects exceeds $1.4 M_u$ due to first-order effects (see Table 5). This indicates that in this building, the weight of the structure is high in proportion to its lateral stiffness leading to excessive PA effect (secondary moments are more than 25 percent of the primary moments). The PA effects will eventually introduce singularities into the solution to the equations of equilibrium, indicating physical structural instability. It was concluded in the literature that the probability of stability failure increases rapidly when the stability index Q exceeds 0.2, which is equivalent to a secondary-to-primary moment ratio of 1.25. The maximum value of the stability coefficient θ (according to ASCE/SEI 7) which is close to stability coefficient Q (according to ACI 318) is 0.25. The value 0.25 is equivalent to a secondary-to-primary moment ratio of 1.33. Hence, the upper limit of 1.4 on the secondary-to-primary moment ratio was selected by the ACI 318.

The moment magnification factor values δ_s calculated in this document and [spColumn](#) are different from the values calculated by the reference. ACI 318 provides three equation options to calculate the effective stiffness modulus $(EI)_{eff}$ as was discussed previously in this document. Equation 6.6.4.4(b) is more accurate than equation 6.6.4.4(a) but is more difficult to use because I_{se} is not known until reinforcement is chosen. The reference used equation 6.6.4.4(a) due to its simplicity while [spColumn](#) uses equation 6.6.4.4(b) since an iterative procedure is used to select the optimum reinforcement configuration.

As can be seen in Table 5 of this example, exploring the impact of other code permissible equation options provides the engineer added flexibility in decision making regarding design. For load combinations 4 - 7 resolving the stability concern may be viable through a frame analysis providing values for V_{us} and Δ_o to calculate magnification factor δ_s and may allow the proposed design to be acceptable. Creating a complete model with detailed lateral loads and load combinations to account for second order effects may not be warranted for all cases of slender column design nor is it disadvantageous to have a higher margin of safety when it comes to column slenderness and frame stability considerations.